




# Water Reporting Summary – South Australian Murray


15 January 2021

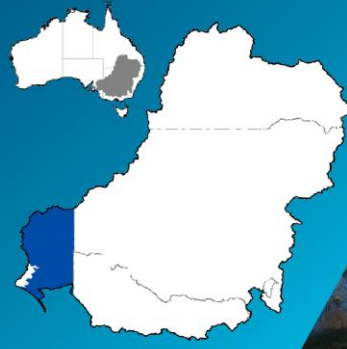

## Overview


- In the last 30 days, there has been limited rainfall across most of the South Australian Murray catchment. Central and southern areas of the catchment received less than 10 mm, while northern parts of the catchment, around Eringa Park and Oakbank Outstation, received 25 to 50 mm of rainfall (Figure 1). The catchment area-average rainfall was 13 mm for the last month. Rainfall in the last month is in the context of the extended dry period from January 2017 with rainfall across most of the South Australian Murray catchment being below or very much below average (Figure 2).
- Water allocations to the majority of entitlement holders reached 100% on 17 August 2020. An update provided on 2 November 2020 confirmed 100% allocation for all entitlement holders (Figure 4). In six out of the last ten years, 100% allocation was announced at the beginning of the water year (1 July).
- Allocation prices are currently \$160 per ML, which is lower than prices in December (\$210 per ML) (Table 1).

## Recent conditions

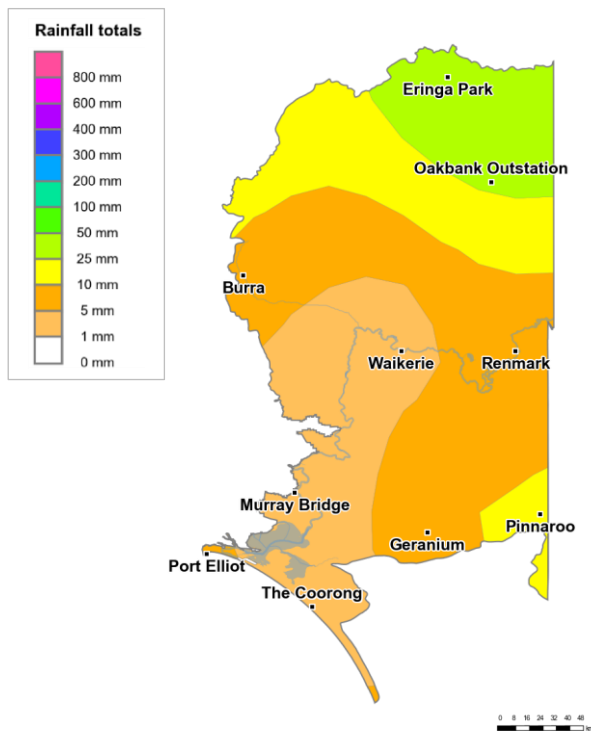

<http://www.bom.gov.au>  
© Commonwealth of Australia 2021, Bureau of Meteorology

Figure 1: Rainfall totals for the last 30 days (17 Dec 2020 to 15 Jan 2021)

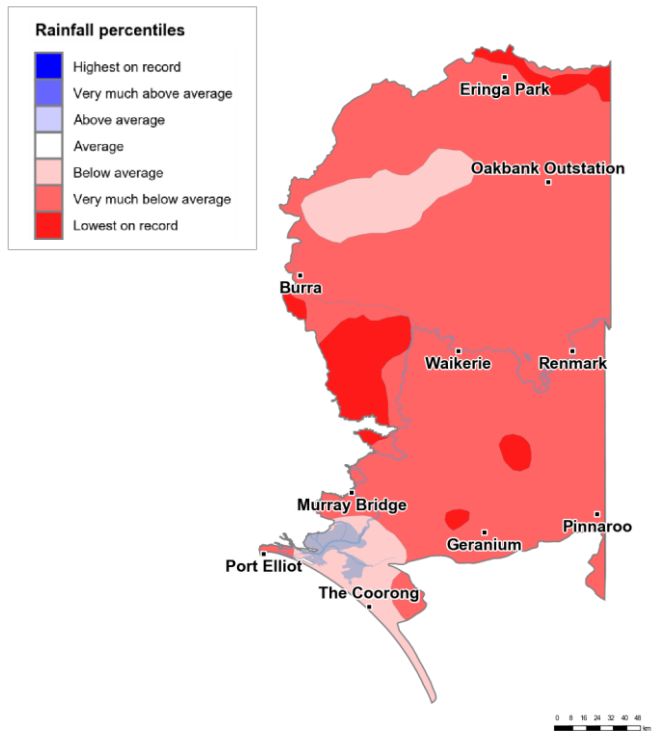

<http://www.bom.gov.au>  
© Commonwealth of Australia 2021, Bureau of Meteorology

Figure 2: Rainfall percentiles since January 2017 (compared to 1900–2019 long-term average) (Jan 2017 to Dec 2020)

Note: Rainfall percentiles for the period from January 2017 are shown as the Bureau of Meteorology considers January 2017 to be the start of the current dry period for eastern Australia.

## How much water is there for the South Australian Murray?

The current projected minimum volume of water available to South Australia by the end of 2020–21: 1 850 GL\*

\*Based on the MDBA's current assessment of water resource availability. It provides for an allocation of 830 GL for consumptive entitlements and an allowance for dilution and losses, and excludes water held under South Australia's Storage Right (338.6 GL as at 1 Jan 2021). The storage right has been set aside under Schedule G of the Murray–Darling Basin Agreement to meet future critical human water needs and private carryover.

Source: [SA Department of Environment and Water](#) and [MDBA](#)

## How much water is in the MDBA operated storages?

Total volume in the MDBA operated storages: 4 927 GL (as at 15 January 2021)

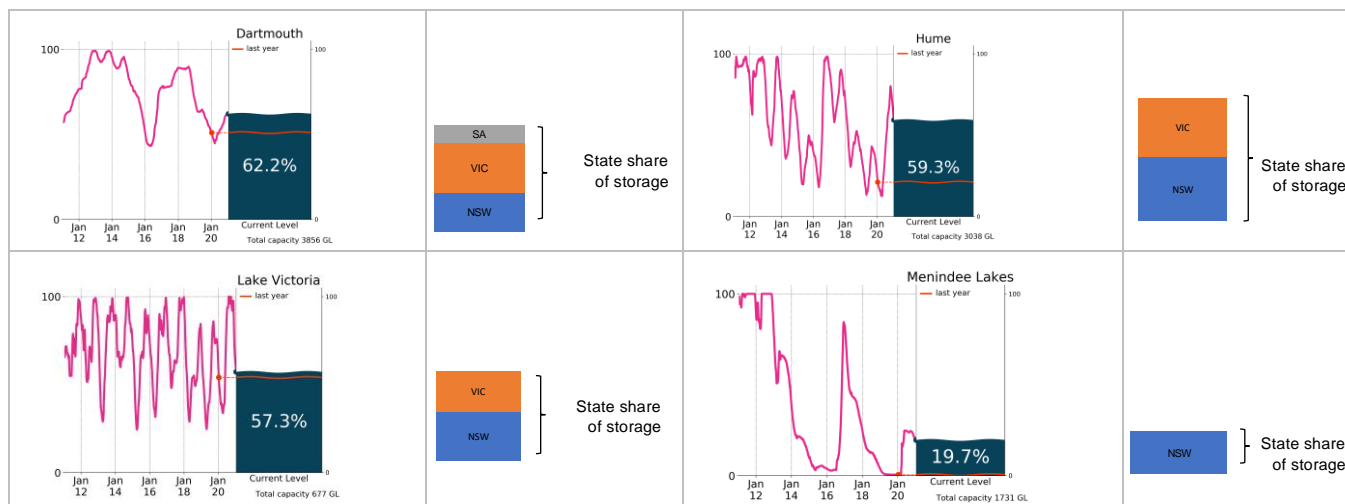


Figure 3: Current total storage (% of total capacity) as at 15 January 2021 compared to the last ten years (State shares updated end Dec 2020)

Source: [BoM water storages dashboard](#) and [MDBA](#)

## Who is the water for?

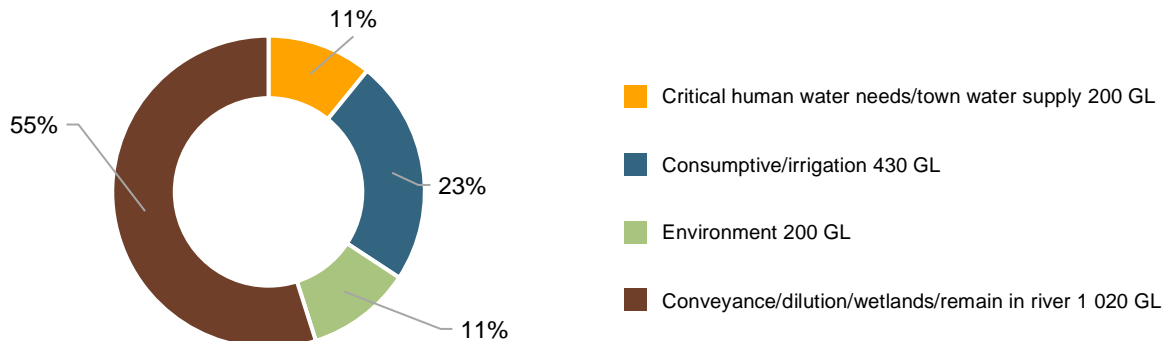


Figure 4: Volumes of water allocated (% of total) for the 2020-21 water year (as at 15 January 2021)

Source: [SA Department of Environment and Water](#)

NB: Information shown is water allocated for various purposes in 2020–21 and is not adjusted for water used or traded.

Table 1: Allocation announcements (%) and market prices – selected licence categories as at 15 January 2021

Licence category	Announced allocation	Historic comparison (same time of year)	Entitlement prices (monthly median)	Allocation price (median – last 7 days)
SA Murray Class 1 (stock and domestic)	100%	Same as most years	n/a	\$160/ML
SA Murray Class 3 (High Security)	100%	In six out of the last ten years, 100% allocation was announced on 1 July.	\$6 700/ML	

Source: [SA Department of Environment and Water](#) and [BoM water markets dashboard](#)

FIND OUT MORE

For more information email [water@bom.gov.au](mailto:water@bom.gov.au)



With the exception of logos, photography and data referenced as being from other organisations, this publication is licensed under a Creative Commons Attribution 3.0 Australia Licence. The terms and conditions of the licence are available at <http://creativecommons.org/licenses/by/3.0/au>. Attribution for this publication should be: © Commonwealth of Australia (Bureau of Meteorology) 2021.